

**TDS CONDUCTIVITY PROBE  
INLINE CONDUCTIVITY MEASUREMENT  
SPS-33**

**DESCRIPTION**

The ADCATrol SPS-33 conductivity probe is used to measure the conductivity (TDS) of the superheated water of boilers or condensate. The probe is used in conjunction with an ADCATrol BCS-211 controller and a VPC series TDS blowdown control valve.

The water contains impurities in form of dissolved solids and solids in suspension, whose concentration increases when it's vaporized. Water treatment can reduce impurities to a certain level, but it does not eliminate them completely and, in certain conditions, it might even increase them. As steam production starts, the concentration of total dissolved solids (TDS) increases in the boiler's water. If the concentration is too high, contamination of steam may occur, resulting in system damage further ahead, such as corrosion and salt incrustations on thermal transference surfaces (among other problems).

This high concentration is harmful and is not acceptable in applications where steam is used for treatment of food, drinks and sterilization processes.

In order to limit the concentration of TDS to a suitable level, a certain amount of boiler water must be periodically eliminated (purge action) and replaced by treated water.

**OPTIONS:** "T" piece type F-3220 for boiler and blowdown valve connection.

**USE:** Superheated boiler water and condensate.

**AVAILABLE MODELS:** SPS-33 – conductivity probe.

**SIZES AND CONNECTIONS:** 1/2" male threaded ISO 228.


**ELECTRICAL CONNECTIONS:** Plug connection with screw terminals, traction relief.

**INSTALLATION:** Horizontal installation.  
Vertical installation possible, under special request.  
See IMI – Installation and maintenance instructions.





**FIRETUBE BOILER AND PNEUMATIC ACTUATED VALVE**

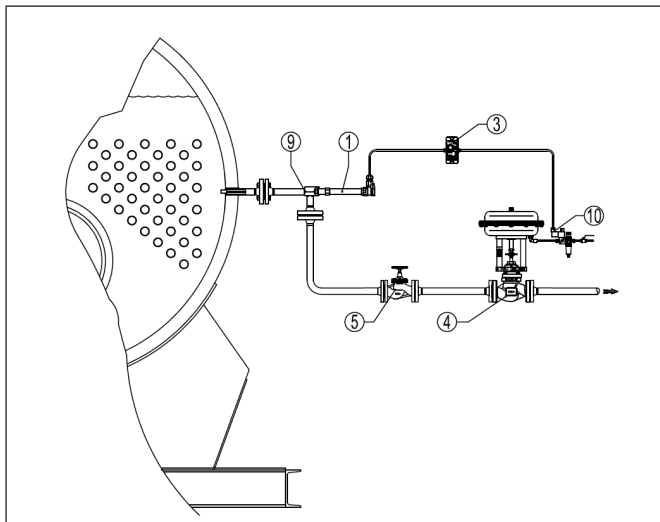

**OPERATION**

The BCS controller (3) is programmed to continuously measure the electrical conductivity (1) of boiler water (closely related to the TDS) and compare it with the set point selected in the controller. It will open the blowdown valve (4) if the measured value is higher, or keep the valve closed until the measured value exceeds the set point.

It is recommended to install a heat recovery system (flash vessel, heat exchanger, etc) before connecting the wasted water to the BEX.

**MATERIALS**

| POS. N° | DESIGNATION                                    |
|---------|--|
| 1       | ADCATrol SPS-33 TDS probe                      |
| 3       | ADCATrol BCS-211 TDS controller                |
| 4       | ADCATrol VPC series TDS blowdown control valve |
| 5       | ADCA VF bellows sealed globe valve             |
| 9       | Tee piece type F-3220                          |
| 10      | SV32C direct solenoid valve                    |